



measurements in mm

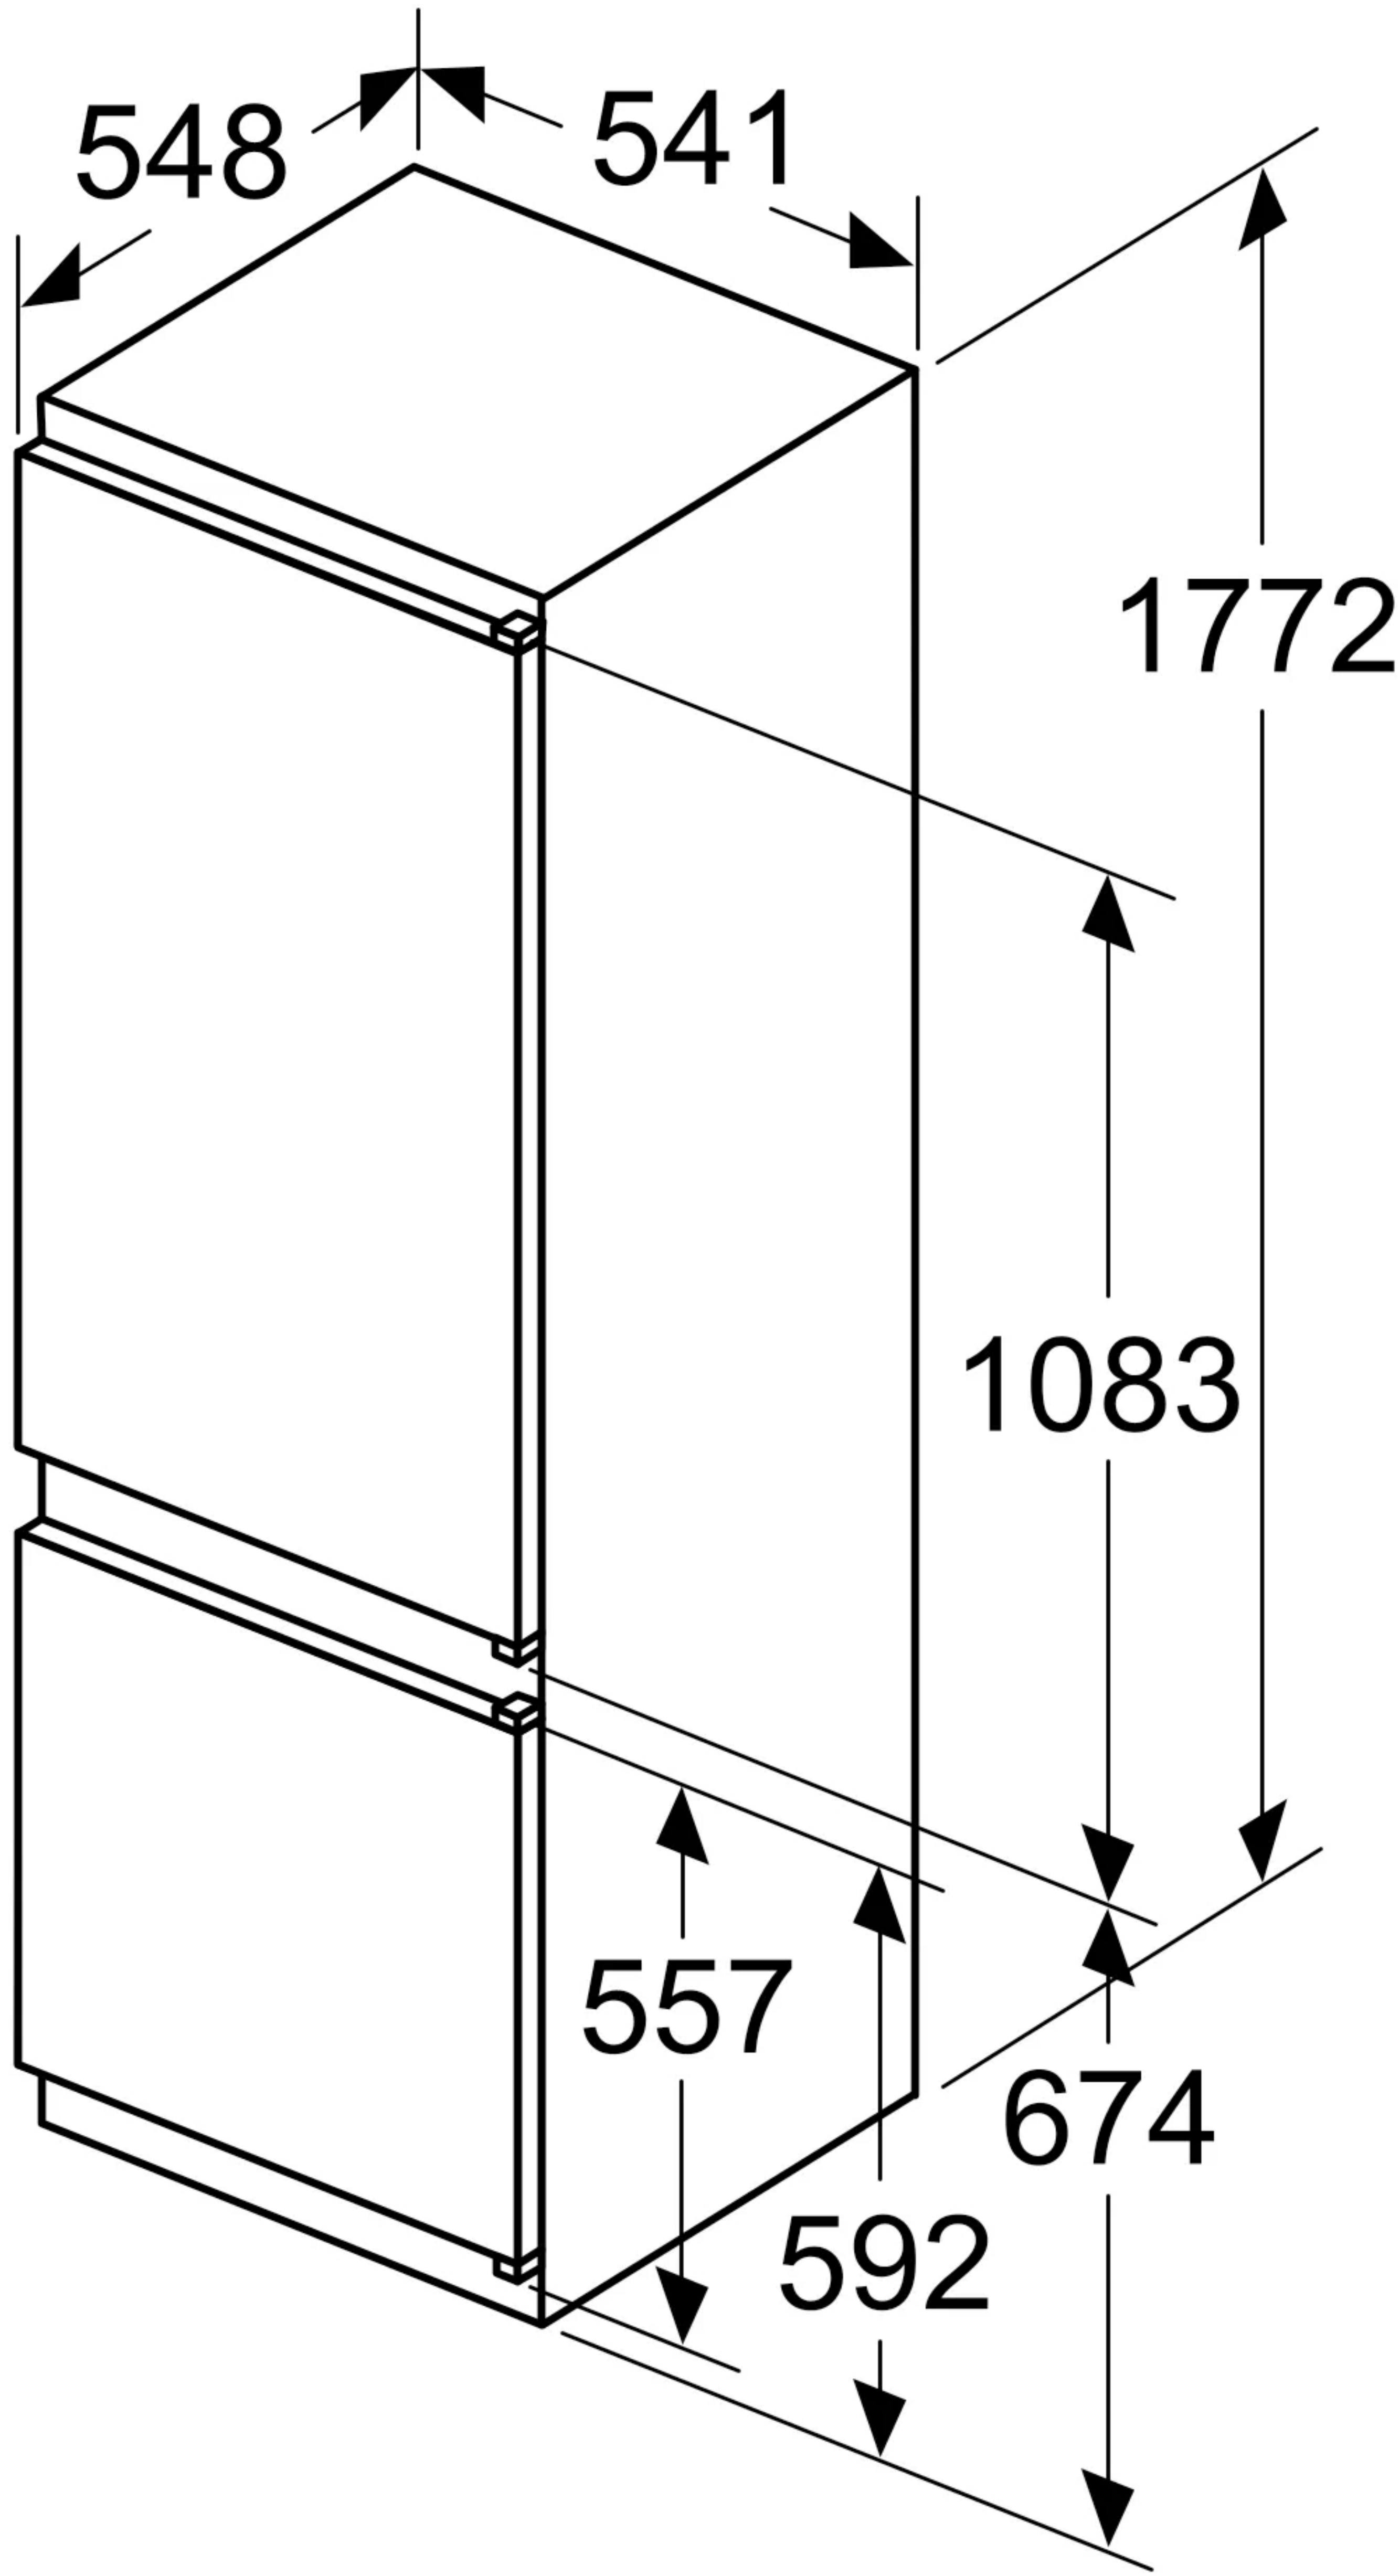


Air outlet
min. 200 cm²

Ventilation
space in
the base
min. 200 cm²

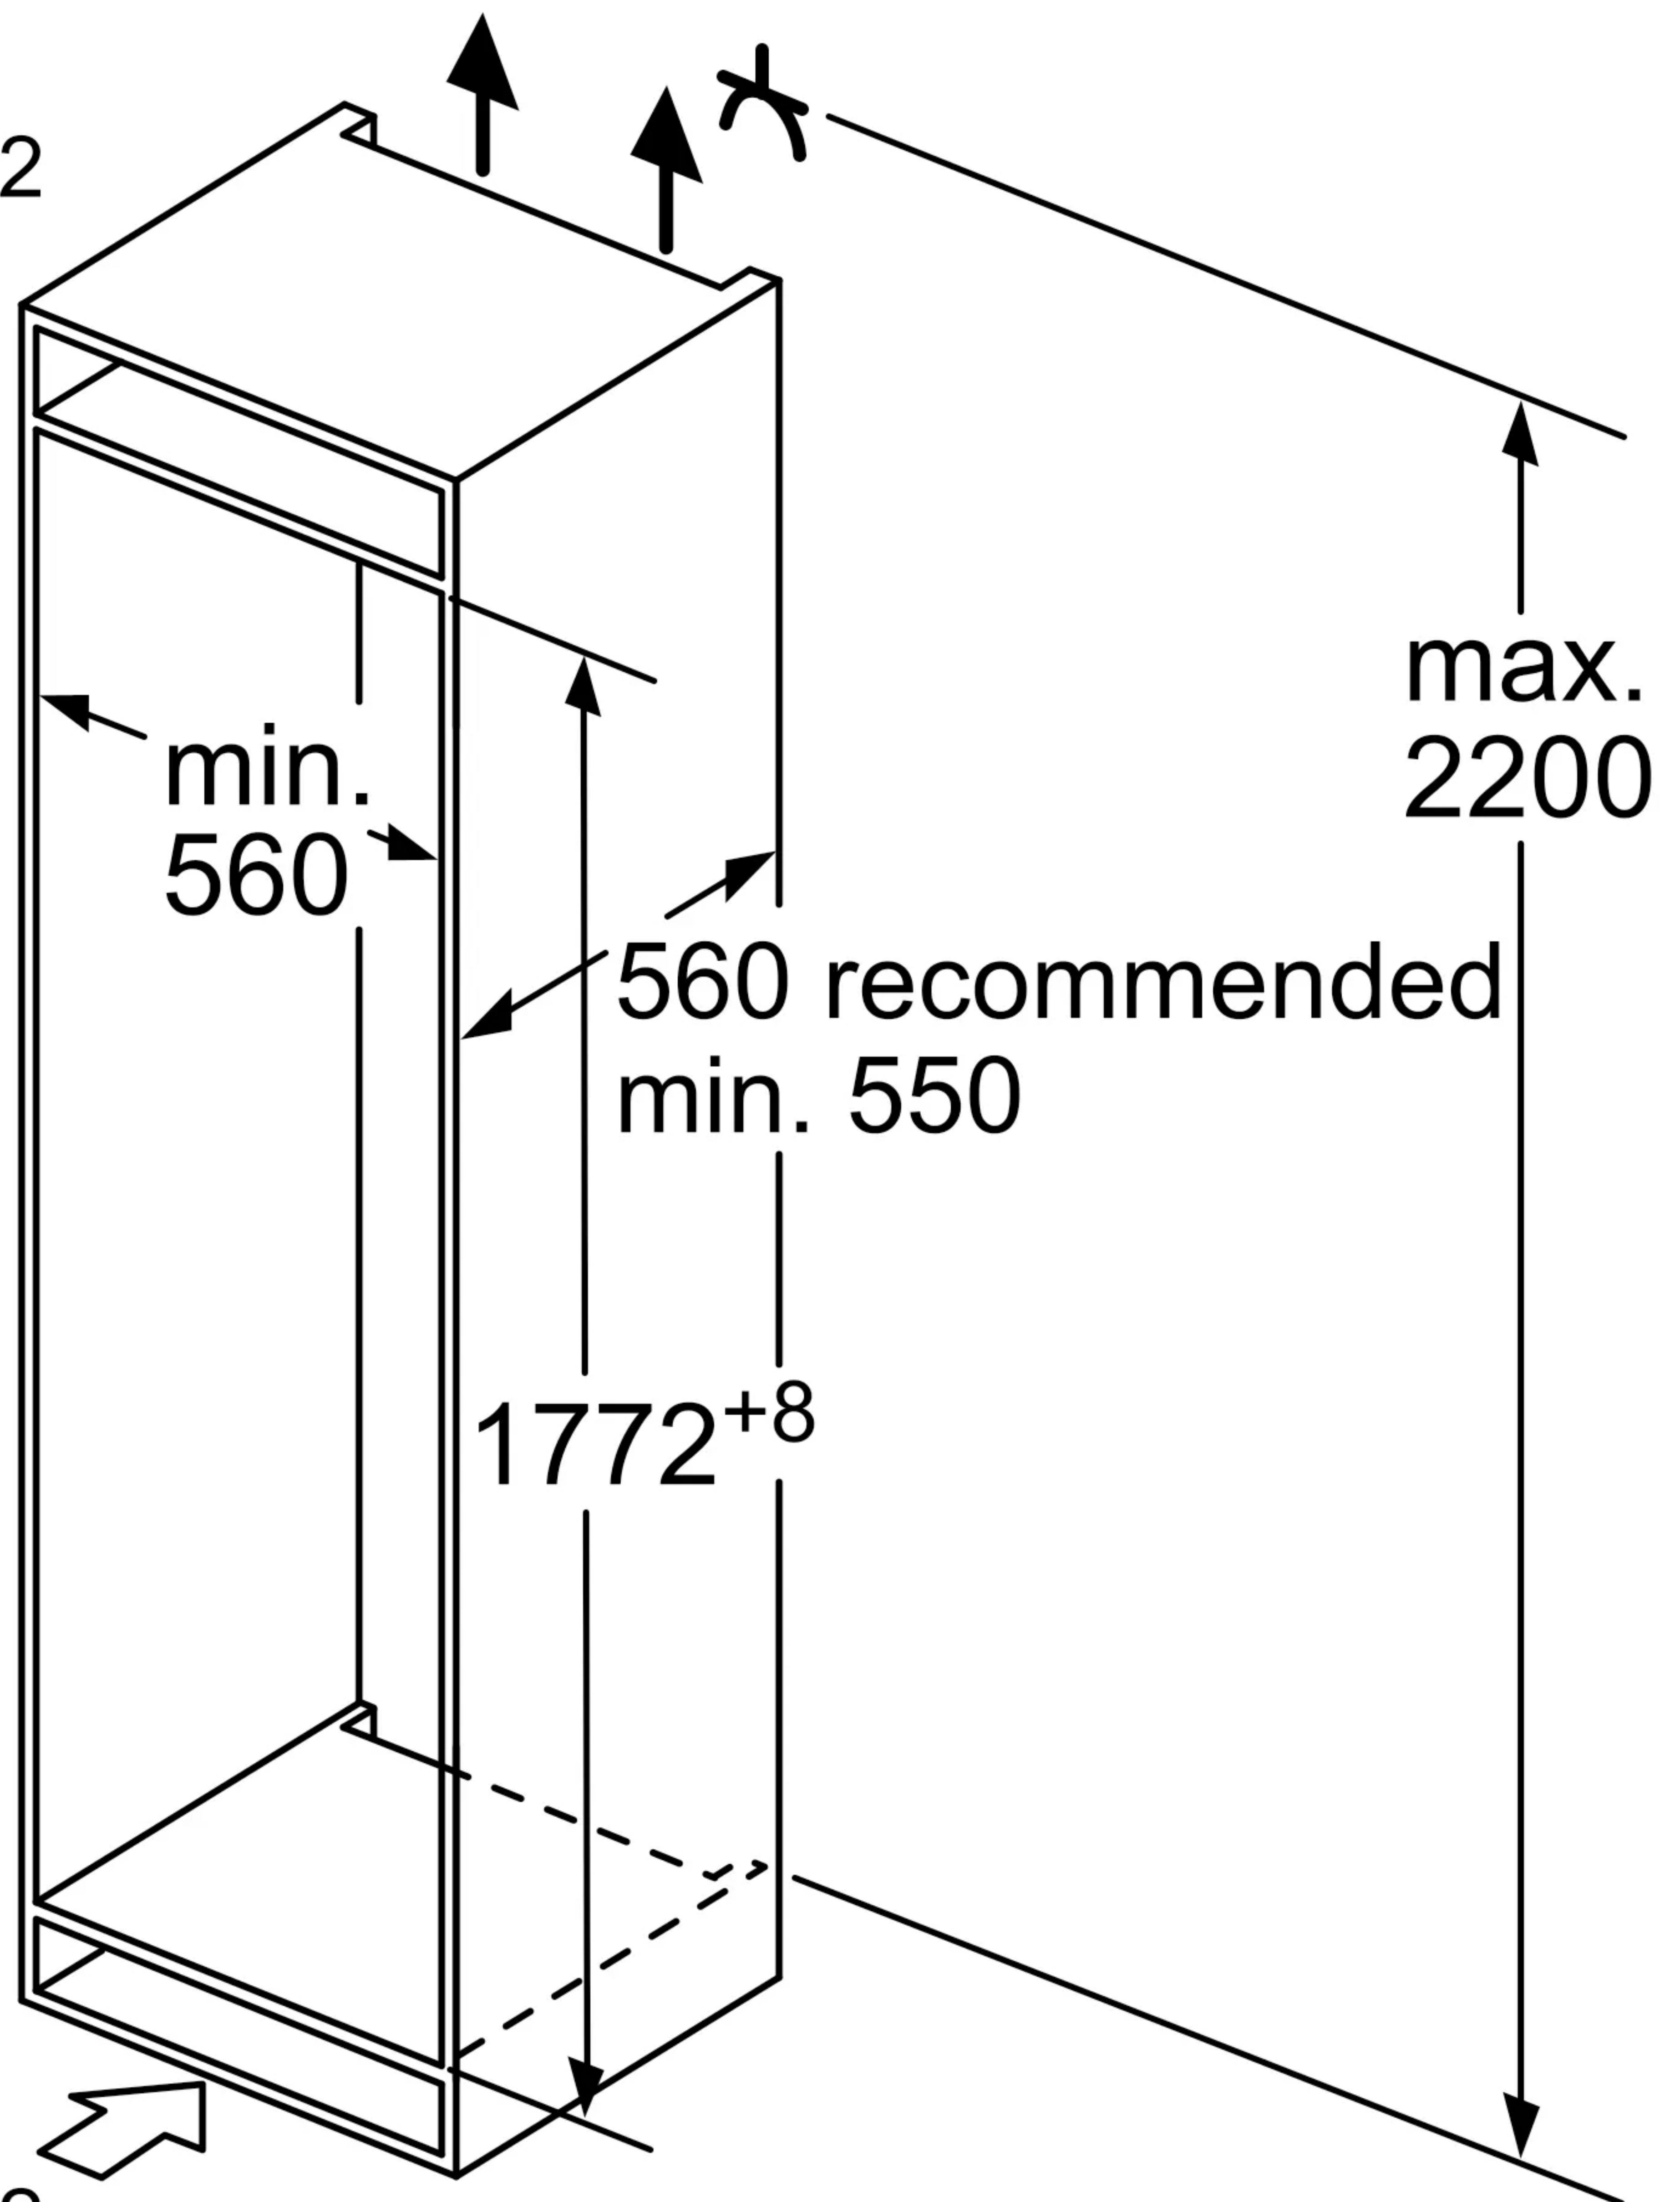


measurements in mm

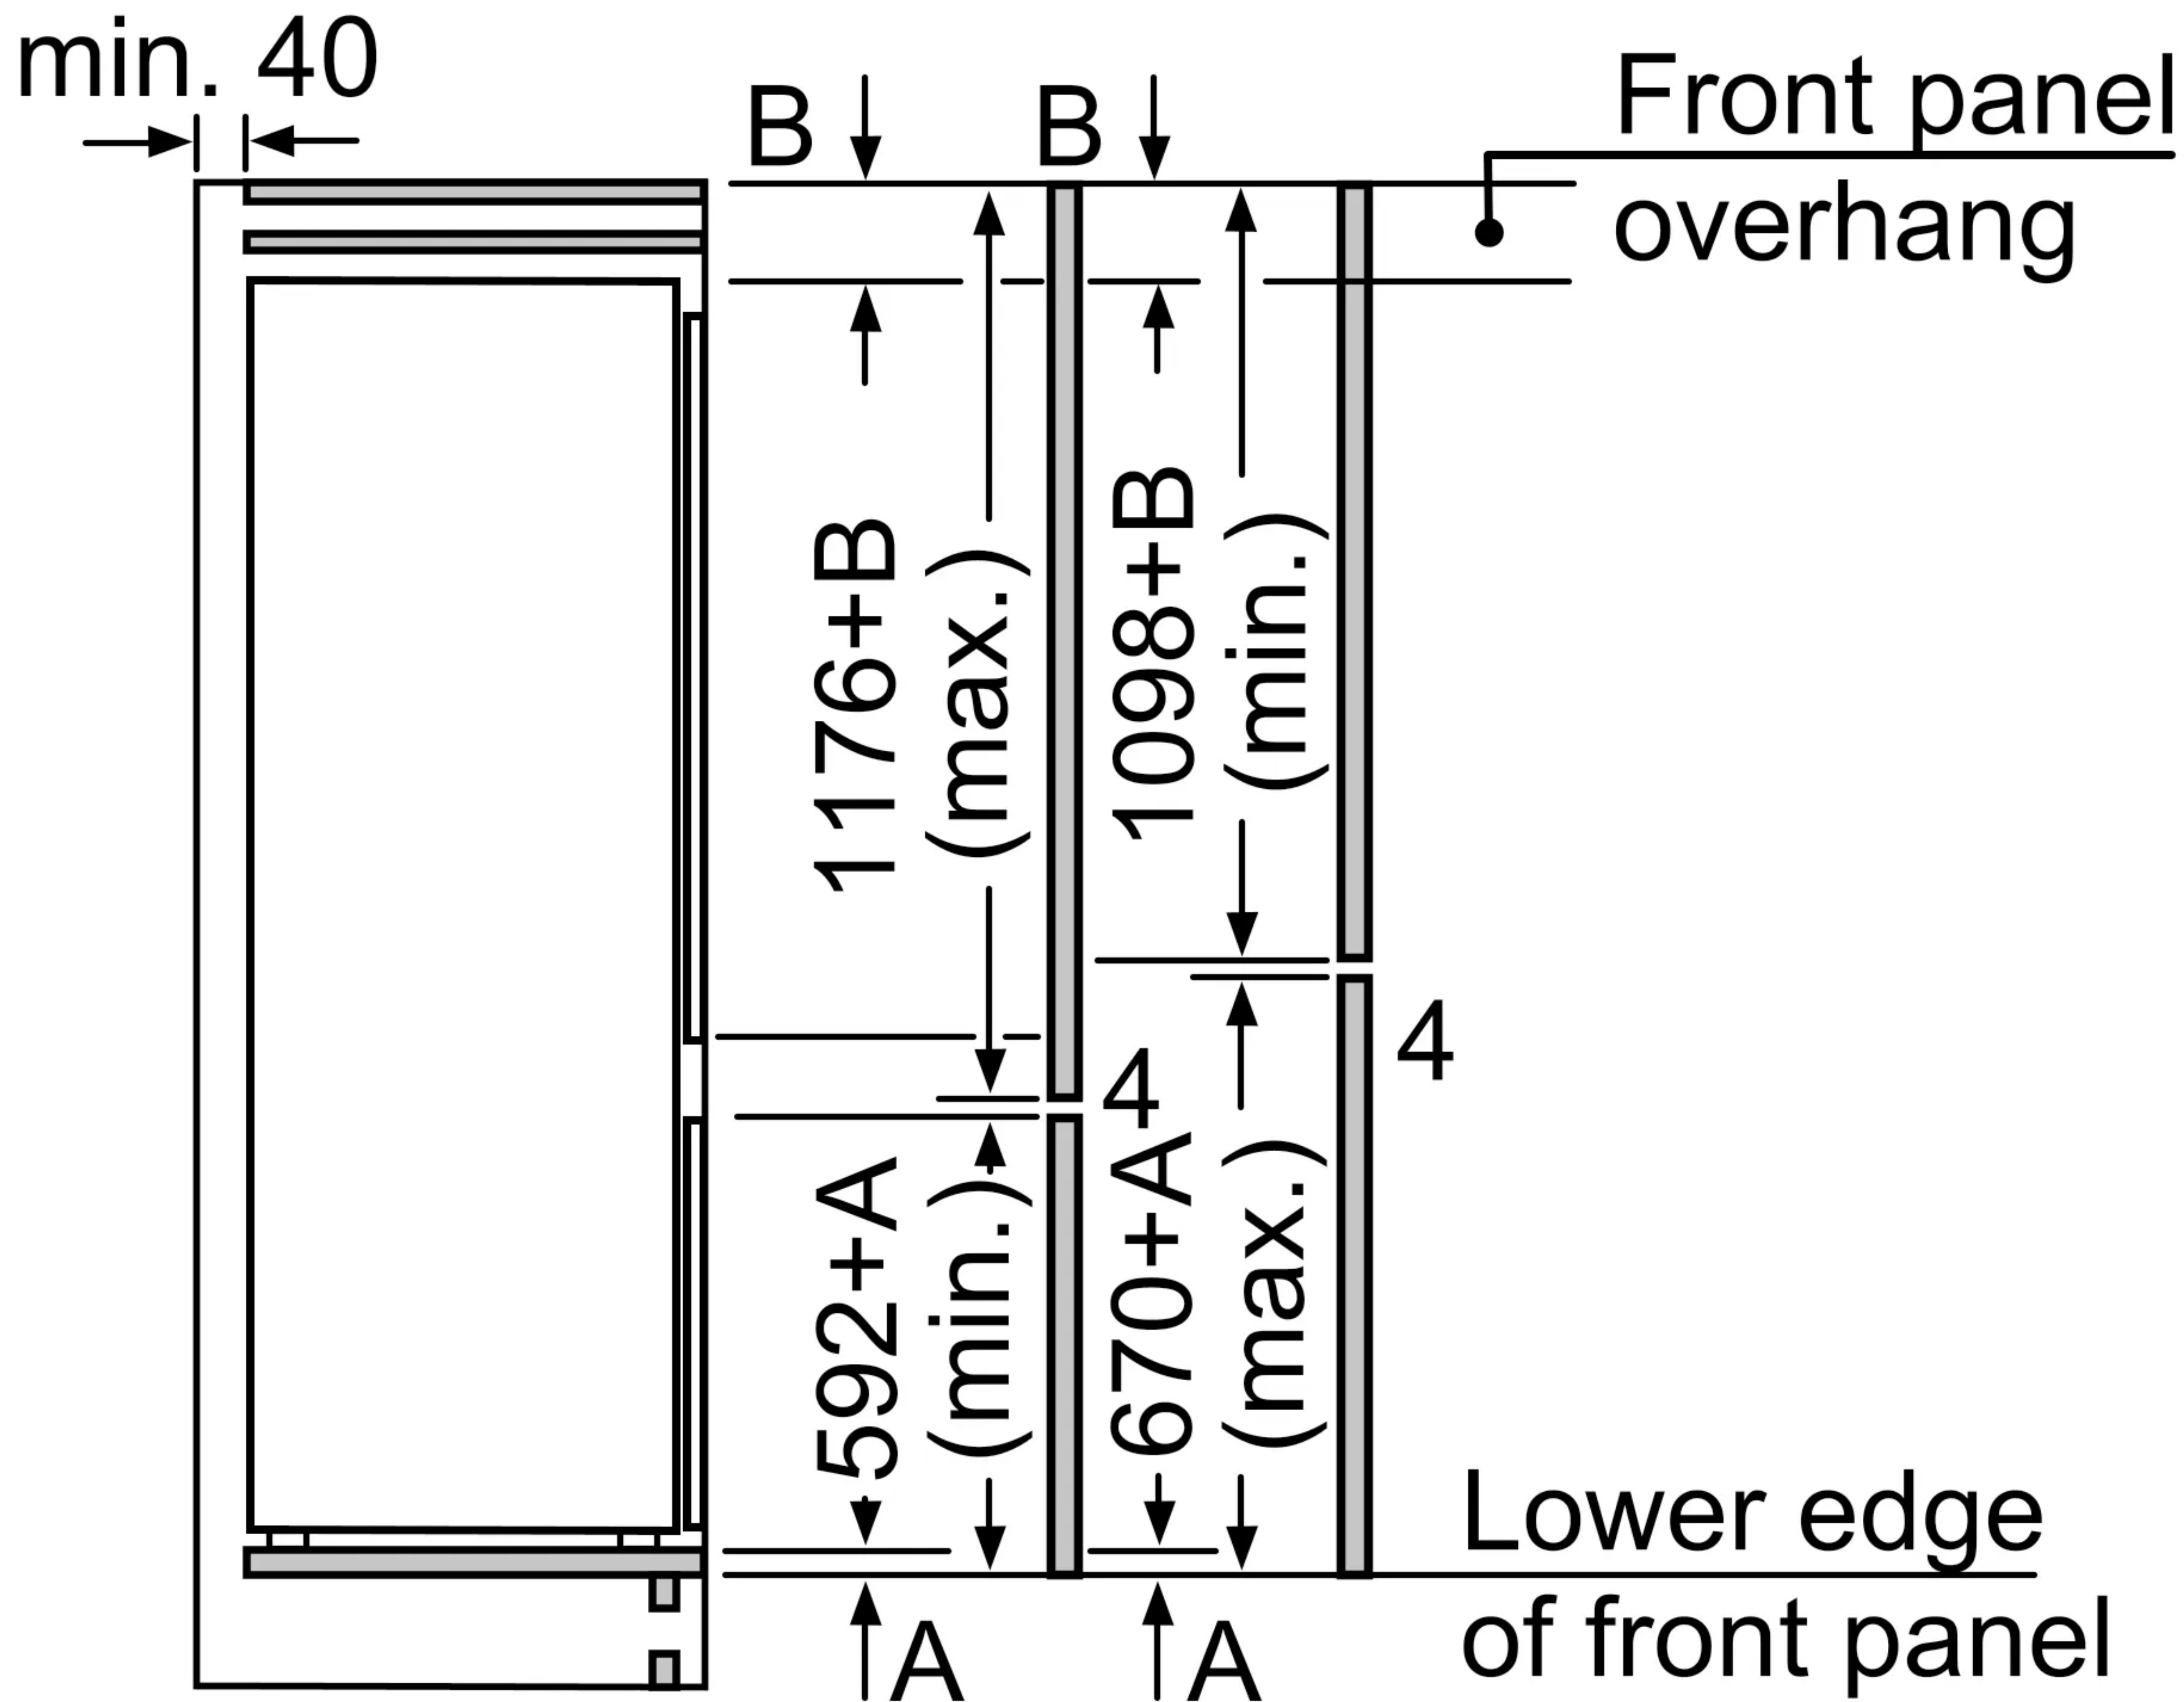

The specified unit door dimensions are valid for a door gap of 4 mm.

measurements in mm

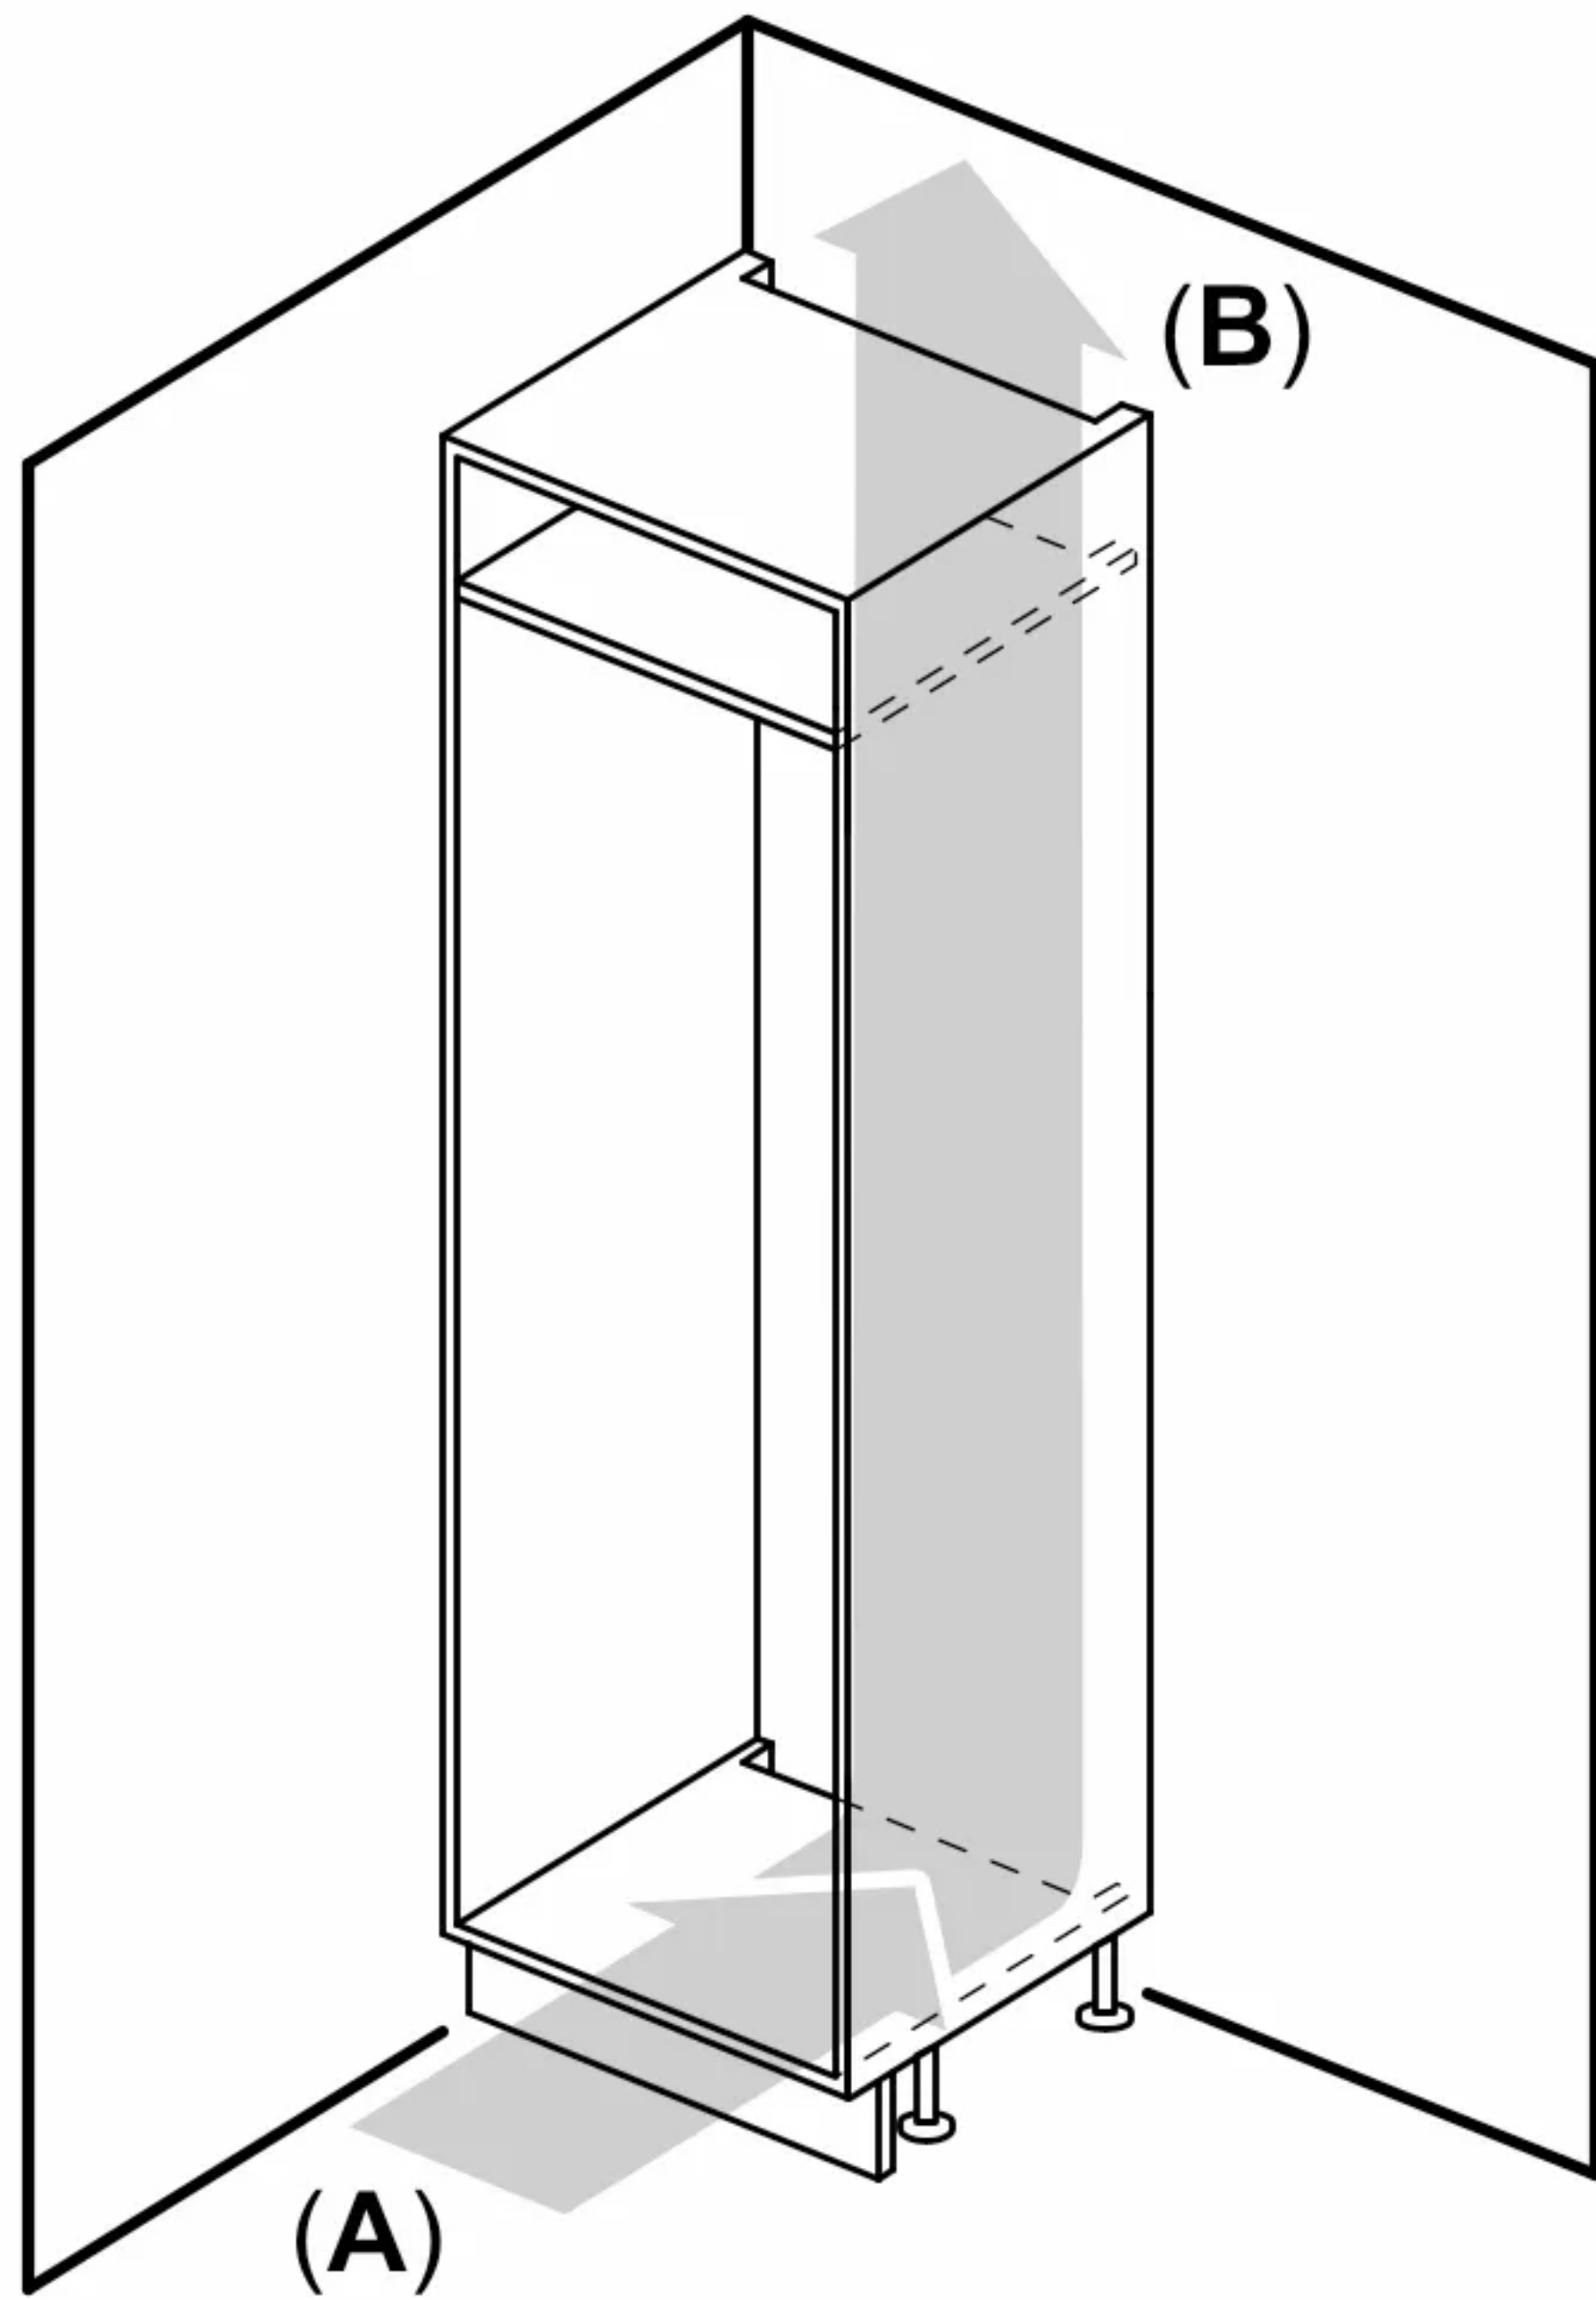

A: Air inlet $\geq 200 \text{ cm}^2$; Ventilation options
B: Air outlet $\geq 200 \text{ cm}^2$; Ventilation options

